

### IMPORTANT SAFEGUARDS

When using electrical equipment, basic safety precautions should always be followed, including the following:

### READ AND FOLLOW ALL SAFETY INSTRUCTIONS

- Do not mount near gas or electric heaters.
- Equipment should be mounted in locations and at heights where it will not be readily subject to tampering by unauthorized personnel.
- The use of accessory equipment not recommended by the manufacturer may cause an unsafe condition.
- Do not use this equipment for other than intended use.
- Servicing of this equipment should be performed by qualified personnel.

### SAVE THESE INSTRUCTIONS

#### Applications

Metrex Egress METEC Series wall surface mount combination exit sign and unit equipment for high abuse environments. See fixture label for restrictions.

**THIS PRODUCT MUST BE INSTALLED IN ACCORDANCE WITH THE APPLICABLE INSTALLATION CODE BY A PERSON FAMILIAR WITH THE CONSTRUCTION AND OPERATION OF THE PRODUCT AND THE HAZARDS INVOLVED. FOLLOW ANY SPECIFIC INSTRUCTIONS ON LUMINAIRE LABELS.**

#### Preparation

- Read all fixture markings and labels to insure correct installation of the fixture. Additional information may be located on the fixture or in supplemental instructions sheets, separate from this instruction sheet, regarding orientation, mounting restrictions and optional equipment.
- For Peace of Mind Warranty, fixture must be mounted to building with at least 4 fasteners (4 point mounting). Attachment to the electrical box only is NOT recommended.
- **WARNING:** Disconnect power to the circuit before wiring fixture.
- Minimum 12" supply wire pigtails must extend from electrical junction box for field connections within fixture enclosure.

#### Installation

**Disassembly** (Figs.1, 2): Remove SHIELD by loosening (4) CAPTIVE SCREWS at corners. Remove INNER COVER by disengaging snaps where shown. Loosen (2) screws retaining REFLECTOR ASSEMBLY. Shift and remove. Remove (4) CHASSIS SCREWS and set aside for reuse. Remove ELECTRICAL CHASSIS assembly.

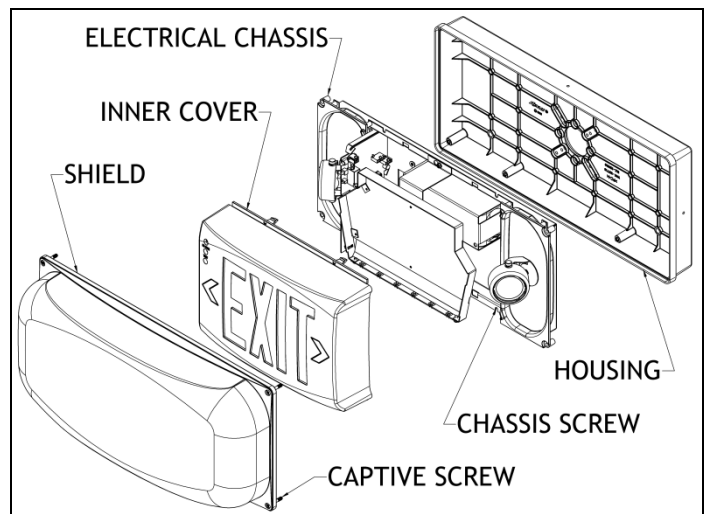


Figure 1

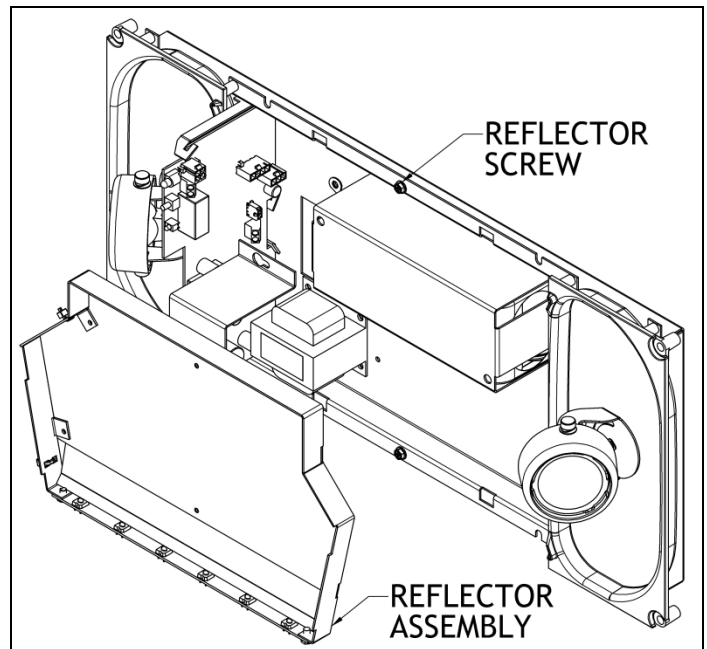


Figure 2

**Mounting** Place HOUSING over an installed electrical junction box (drill points provided for temporary j-box attachment prior to permanent mounting). Locate and drill 4 pilot holes in mounting surface using HOUSING as a template. (Fig.3): For wet location installation, attach self-adhesive pad GASKETS to HOUSING at (4) mounting holes and center wiring hole. Using ¼” fasteners and anchors appropriate for the mounting surface (not supplied), attach HOUSING to structure.

**Conduit Attachment** (Fig. 4) ½” trade size conduit may be used for power entry into top, bottom or sides of HOUSING. Locate suitable drill point and drill 7/8” dia. hole. Use proper conduit hub and locknut for wet or damp/dry location installation (not supplied).

**Wiring** (Figs. 1, 2, 5, 6): Reinstall ELECTRICAL CHASSIS assembly using the CHASSIS SCREWS, observing proper orientation (PC board at left), routing 12” supply wire pigtails through opening in GEAR TRAY. Connect supply ground to GROUND WIRE provided. Connect supply wires to appropriate TRANSFORMER leads. Lead color coding: White= Neutral, Black= 120V, Orange= 277V, Blue= 347V. Separately cap off all unused leads. Connect remote loads (if used) to appropriate terminal blocks. Refer to chart for maximum allowable loads.

**CAUTION: To avoid electrical overload, total connected lamp load (factory and field installed) should not exceed output rating.**

Battery	Internal Lamps	Maximum Remote Lamp Load	
		12VDC Emergency	4VDC Exit Signs
24N	2X6.5L	11W	1
	4X6.5L	N.A.	
40N	2X6.5L	27W	
	4X6.5L	14W	

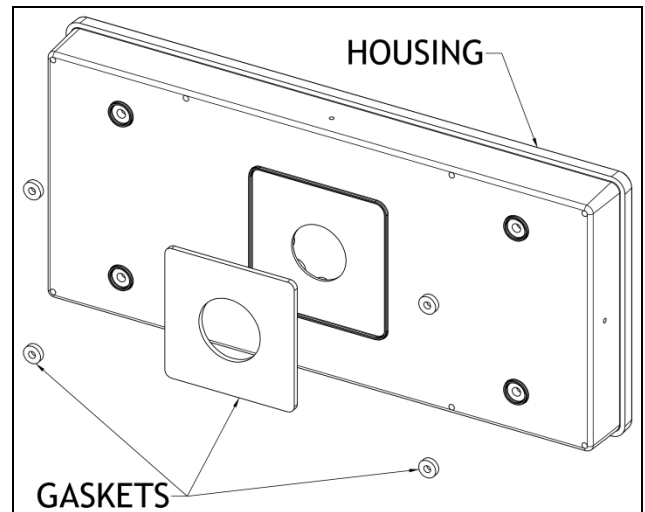


Figure 3

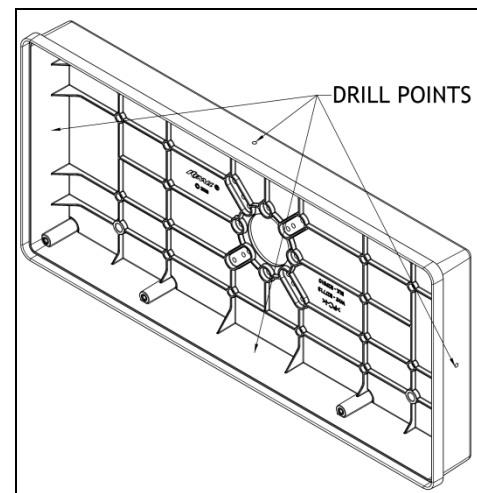


Figure 4

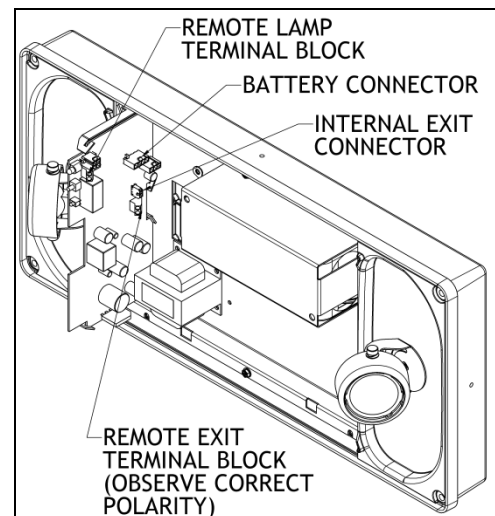


Figure 5

## Wiring, cont'd.

- After installing ELECTRICAL CHASSIS and making field wiring connections (AC power OFF), connect the battery to the polarized 4-pin BATTERY CONNECTOR on the PC board assembly. On units equipped with two batteries, BATTERY CONNECTOR #1 should always be connected first and disconnected last.
- Upon connection of final BATTERY CONNECTOR, the emergency lamps will illuminate for a few seconds and then extinguish. This signals that the batteries are properly connected and are protected from discharging until AC power is established.
- Connect exit sign power cable from REFLECTOR ASSEMBLY to polarized INTERNAL EXIT CONNECTOR on PC board. Reattach REFLECTOR ASSEMBLY to ELECTRICAL CHASSIS, observing proper orientation (LED strip at bottom), and tighten REFLECTOR SCREWS.

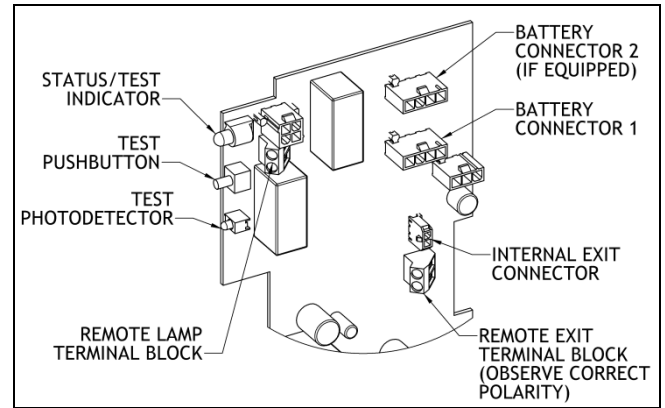


Figure 6

**Directional Indicators** (Fig. 7): Configure DIRECTIONAL ARROWS as needed. To remove DIRECTIONAL ARROW COVER, use 7/16" nut driver (not supplied) to loosen RETAINER NUT approx. one complete turn. Push in cover from outside. Tighten RETAINER NUT to secure COLOR FILTER PANEL and aluminum LIGHT MASK (if provided). Carefully align INNER COVER over TEST PUSHBUTTON and STATUS/TEST INDICATOR. Snap INNER COVER to ELECTRICAL CHASSIS assembly.

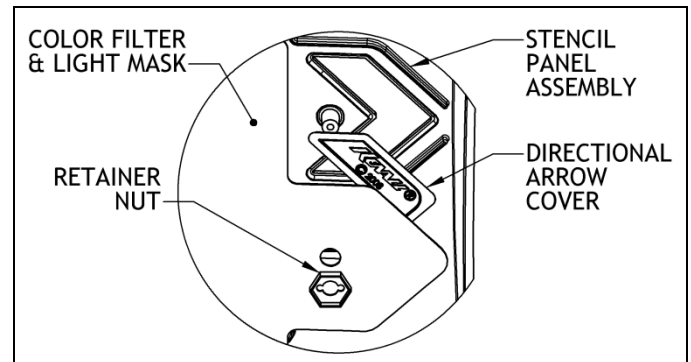


Figure 7

Refer to Kenall document F-2933 Metrex Egress METEC Operation Instructions for more information.

## WARRANTY

For warranty information visit [www.kenall.com/Resources/Certified-Performance-Warranties](http://www.kenall.com/Resources/Certified-Performance-Warranties)